



# FORM 6 (B) UTILITY POINT

**Deadline**  
**27 JUNE 2022**

**Attn: Ms. Aor Threephed**

**Tel : (66)9 851 62894**  
**Fax: (66)2 053 9525**


**Email : Threephed.mee@gmail.com**

Company Name : \_\_\_\_\_ Stand No : \_\_\_\_\_  Standard Booth  Raw Space  
 Tax ID : \_\_\_\_\_  Head Office  Branch No \_\_\_\_\_ (require 5 digit)  
 Address Company : \_\_\_\_\_  
 Tel : \_\_\_\_\_ Fax : \_\_\_\_\_ Phone : \_\_\_\_\_  
 Coordinated by : \_\_\_\_\_ Position : \_\_\_\_\_ Email : \_\_\_\_\_  
 Account : \_\_\_\_\_ (If there) Position : \_\_\_\_\_  
 Approved by : \_\_\_\_\_ Position : \_\_\_\_\_ Date : \_\_\_\_\_

Please indicate location of needed utility point on the form. Otherwise, we will place these utilities point on our contractor's discretion. We will not be responsible for any relocation.

กรณีการระบุตำแหน่งของจุดสาธารณูปโภคที่ต้องการในแบบฟอร์ม มิฉะนั้น บริษัทจะติดตั้งลงตามดุลยพินิจของผู้รับเหมา และจะไม่รับผิดชอบในการย้ายตำแหน่งสาธารณูปโภคที่ได้ติดตั้งไปแล้ว

	<b>Spotlight standard</b>		<b>Connecting (by MEE)</b> จุดต่อไฟ (โดย MEE)
	<b>Spotlight / arm</b>		<b>Connecting (by Exhibitor)</b> จุดต่อไฟ (โดยผู้แสดงสินค้า)
	<b>Fluorescent Lamp</b>		<b>Water</b> น้ำประปา
	<b>Breaker</b>		<b>Drain</b> ท่อระบายน้ำ
	<b>Socket Point</b>		<b>Compressed Air</b> เครื่องปั๊มลม

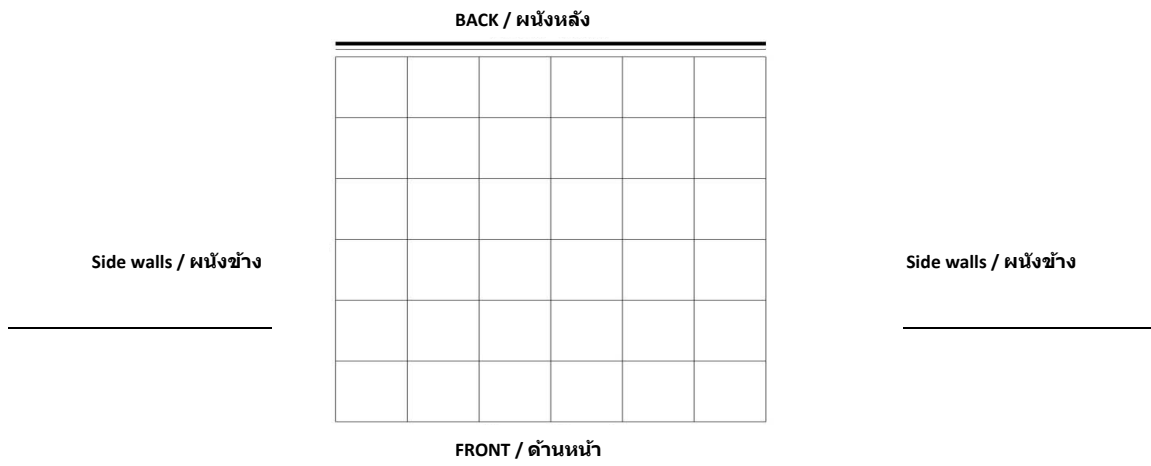

**REMARKS:**

- If there is a request to move equipment for electrical charge 250 baht / service points and moved breakers 1 Phase for 1,500 baht / line.
  - If a breaker 60A380V3P to charge move for 2,500 baht / line (prices do not include Vat 7%).
- \* The standard supply is 110V, 220V or 380V with approximately 10% fluctuation. For the safety of your equipment, please use a stabilizer.  
 \*\* The internal wiring system, Power supply required meets the standard operation procedure for electricity (fully grounded wiring) for safety.